


**Rinnai Tankless
Single Unit D'MAND System with Hydronic Furnace**

For this application:

- Demand circulator controller should be controlled by push button, motion sensor or door contact.
- Demand Circulator should be designed specifically for tankless water heaters.
- Ensure Demand Circulator is sized for flow rate and pressure drop of circulation loop or a minimum of 3 gpm @ 28ft head.
- Demand Circulator to be of bronze or stainless steel construction.

Rinnai Equipment List	QTY
Rinnai Water Heaters	1
Rinnai Hydronic Furnace	1

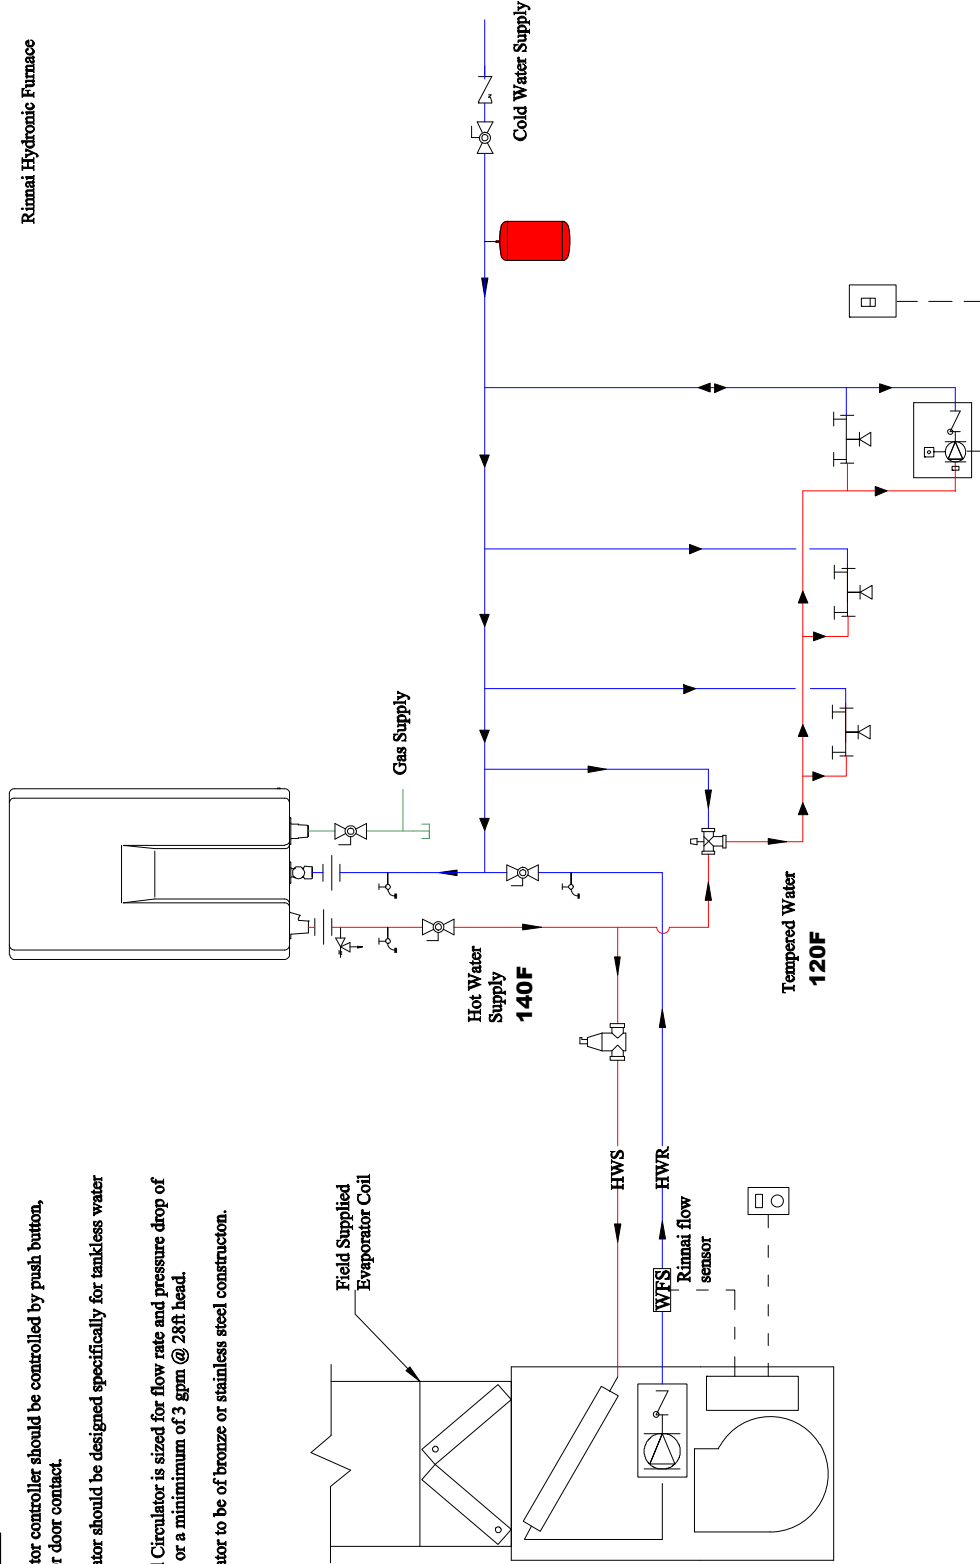

This is not an engineering drawing; it is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

Rinnai America Corporation
103 International Drive
Peachtree City, GA 30269
1-800-621-9419

Rinnai
Tankless
D'MAND System Hydronic Furnace

Drawn By	DRM	DATE	03/02/11
Approved By	RS	DWG NO.	WH1-A1-CD
Scale	N.T.S.	REV	D
Tolerance	Frac: 1/16" = ±1/16"	SHEET 1 of 1	
	XXX=±0.030		
	XXXX=±0.015		
	XXXXX=±0.005		